

# Certificate of Compliance

Certificate Number 20080430-R6666  
Report Reference R6666  
Issue Date 2008 April 30

Page 1 of 2



**Underwriters  
Laboratories Inc.®**

*Issued to:* Curries Div. of Assa Abloy Door Group LLC

525 9th St SE  
Mason City, IA 50401

*This is to certify that  
representative samples of*

**Swinging Type Fire Doors**  
Model 727 - Mineral Core, Temperature Rise

*Have been investigated by Underwriters Laboratories Inc.® (UL) or any authorized licensee of UL in accordance with the Standard(s) indicated on this Certificate.*


*Standard(s) for Safety:*

UL 10B - Fire Tests of Door Assemblies, UL 10C (1998)- Standard for Positive Pressure Tests of Door Assemblies, UBC 7-2 (1997) Part 1 - Fire Tests of Door Assemblies, NFPA 252 - Fire Tests of Door Assemblies, ASTM E-152 - Standard Method of Fire Tests of Door Assemblies, CAN4-S104-1980 - Standard Method for Fire Tests of Door Assemblies, BS 176- Method for Determination of Fire Resistance of Elements of Construction

*Additional Information:*

4'8" x 8'0" single doors  
8'0" x 8'0" pairs of doors swinging in the same direction  
8'0" x 8'0" double egress pairs

Only those products bearing the UL Classification Mark should be considered as being covered by UL's Classification and Follow-Up Service.

The UL Classification Mark includes: UL in a circle symbol:  with the word "CLASSIFIED" (as shown); a control number (may be alphanumeric) assigned by UL; a statement to indicate the extent of UL's evaluation of the product; and, the product category name (product identity) as indicated in the appropriate UL Directory.


**Look for the UL Classification Mark on the product**

Issued by:

  
Mona Couloute

Underwriters Laboratories Inc.

Reviewed by:


  
Matthew Schumann

Underwriters Laboratories Inc.

# Certificate of Compliance

Certificate Number 20080430-R6666  
Report Reference R6666  
Issue Date 2008 April 30

Page 2 of 2

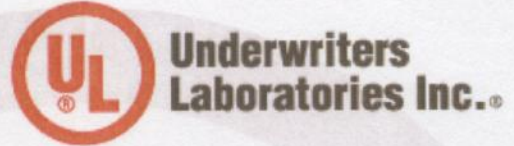

All doors have 18 or 16 gauge face skins and are rated up to and including 3 hrs.  
Listed single point locks, fire exit hardware and auxiliary hardware may be used.  
Flat or Z astragals are required on all positive pressure rated temperature rise pairs.  
Open back strikes may be used on pairs of 8'0" x 8'0" doors.

This is to verify that representative samples of the product as specified on this certificate were tested according to the current UL requirements.

Issued by:

*Mona Couloute*  
Mona Couloute

Underwriters Laboratories Inc.

Reviewed by:

*Matthew Schumann*  
Matthew Schumann

Underwriters Laboratories Inc.